

tel.: (+48 22) 825-04-71 (+48 22) 825-76-55 fax: (+48 22) 825-52-86

www.itb.pl





# European Technical Assessment

ETA-15/0342 of 30/06/2015

### **General Part**

Technical Assessment Body issuing the European Technical Assessment

Trade name of the construction product

Product family to which the construction product belongs

Manufacturer

Manufacturing plant(s)

This European Technical Assessment contains

This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of

Instytut Techniki Budowlanej

MULTIFIX PSF

Injection anchors for use in masonry

EJOT BAUBEFESTIGUNGEN GmbH In der Stockwiese 35 D-57334 Bad Laasphe Germany

Factory 1

14 pages including 3 Annexes which form an integral part of this Assessment

Guideline for European Technical Approval of "Metal injection anchor for use in masonry", ETAG 029, Edition April 2013 used as European Assessment Document (EAD)

This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

### **Specific Part**

### 1 Technical description of the product

The Injection system MULTIFIX PSF is a bonded anchor (injection type) consisting of a mortar cartridge with MULTIFIX PSF injection mortar, a perforated sleeve and an anchor rod with hexagon nut and washer size M10. The steel elements are made of zinc coated carbon steel.

The anchor rod is placed into a drilled hole filled with injection mortar and is anchored via the bond between steel element, injection mortar and masonry and mechanical interlock.

The illustration and the description of the product are given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performances given in Annex C are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer or Technical Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

## Performance of the product and references to the methods used for its assessment

### 3.1 Performance of the product

### 3.1.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for tension and shear loads	Annex C1
Characteristic resistance for bending moments	Annex C1
Displacements under shear and tension loads	Annex C1
Reduction Factor for job site tests (β-Factor)	Annex C2
Edge distances and spacings	Annex C2

### 3.1.2 Safety in case of fire (BWR 2)

<b>Essential characteristic</b>	Performance	
Reaction to fire	Anchorages satisfy requirements for Class A1	
Resistance to fire	No performance assessed	

### 3.1.3 Hygiene, health and the environment (BWR 3)

In addition to the clauses relating to dangerous substances contained in this European Technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of

the regulation (EU) No 305/2011, these requirements need also to be complied with, when and where they apply.

### 3.1.4 Safety in use (BWR 4)

For basic requirement safety in use the same criteria are valid as for basic requirement mechanical resistance and stability.

### 3.1.5 Sustainable use of natural resources (BWR 7)

No performance assessed.

### 3.1.6 General aspects relating to fitness for use

Durability and serviceability are only ensured if the specifications of intended use according to Annex B1 are kept.

### 3.2 Methods used for the assessment

The assessment of fitness of the anchor for the declared intended use in relation to the requirements for mechanical resistance and stability and safety in use in the sense of the Basic Requirements 1 and 4 has been made in accordance with the ETAG 029 "Metal injection anchor for use in masonry".

# 4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to the Decision 97/177/EC of the European Commission the system of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table is applied.

Product Intended use		Level or class	System	
Metal injection anchors for use in masonry	Fixing and/or support to masonry, structural elements (which contribute to the stability of the works) or heavy units such as cladding as well as installation	_	1	

# Technical details necessary for the implementation of the AVCP system, as provided in the applicable European Assessment Document (EAD)

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited in Instytut Techniki Budowlanej.


For the type testing the results of the tests performed as part of the assessment for the European Technical Assessment shall be used unless there are changes in the production line or plant. In such cases the necessary initial type testing has to be agreed between Instytut Techniki Budowlanej and the notified body.

Issued in Warsaw on 30/06/2015 by Instytut Techniki Budowlanej

Marcin M. Kruk, Dr. Eng.

Director of ITB

### Schema of the anchor in use

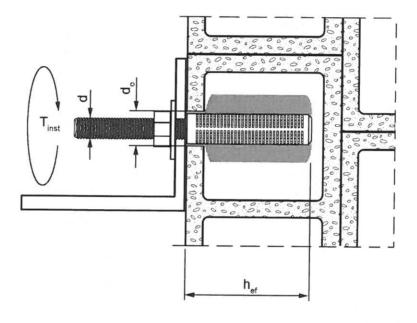

### **MULTIFIX PSF**

**Product description** Installation conditions

### Annex A1

of European Technical Assessment ETA-15/0342

### Mortar cartridges and applicator guns:

	Cartridge	Applicator gun
coaxial cartridge: 150 ml		
side-by-side cartridge: 235 ml 345 ml 825 ml		*
coaxial cartridge: 380 ml 400 ml 410 ml		-
two-layers cartridge with plastic insert 150 ml 165 ml 170 ml 280 ml 300 ml 410 ml		


### Special mixing nozzle:



MULTIFIX PSF	Annex A2
Product description Injection system	of European Technical Assessment ETA-15/0342

# Anchor rods Flat tip One side 45 chamfer Two sides 45 chamfer

### Perforated plastic sleeve

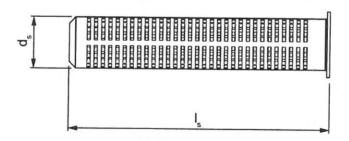

### **MULTIFIX PSF**

Product description
Threaded rods and sleeve

### Annex A3

of European Technical Assessment ETA-15/0342

**Table A1: Materials** 

Part Designation		Material	
1	Chemical mortar	Polyester, styrene free resine mortar, hardener, additive	
2	Anchor rod	Carbon steel class 5.8, EN ISO 898-1, zinc plated ≥ 5 µm, EN ISO 4042	
3	Washer	Carbon steel, zinc plated ≥ 5 μm, EN ISO 4042	
4	Hexagonal nut	Carbon steel class 5, EN 20898-2, zinc plated ≥ 5 µm, EN ISO 4042	
5	Perforated sleeve	Polyethylene	

**MULTIFIX PSF** 

Product description Materials Annex A4

of European Technical Assessment ETA-15/0342

### Specification of intended use

### Anchorages subject to:

Static and quasi-static loads

### Base materials:

- Perforated ceramic blocks (use category c), according to Annex B2.
- Mortar strength class of the masonry M2,5 at minimum according to EN 998-2:2010.
- For other perforated, ceramic blocks the characteristic resistance of the anchor may be determined by job site tests according to ETAG 029, Annex B under consideration of the β-factor according to Annex C2, Table C4.

### Temperature range:

■ Tb: -40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C).

### Use conditions (Environmental conditions):

Structures subject to dry internal conditions (zinc coated steel).

### Use categories:

- c base material.
- w/d installation and use.

### Design:


- Verifiable calculation notes and drawings are prepared taking account the relevant masonry in the region of the anchorage, the loads to be transmitted and their transmission to the supports of the structure. The position of the anchor is indicated on the design drawings.
- The anchorages are designed in accordance with to the ETAG 029, Annex C, design method A under the responsibility of an engineer experienced in anchorages and masonry work.

### Installation:

- Dry internal structures.
- Hole drilling by rotary drill mode.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.

MULTIFIX PSF	Annex B1
Intended use Specifications	of European Technical Assessment ETA-15/0342

Table B1: Base material

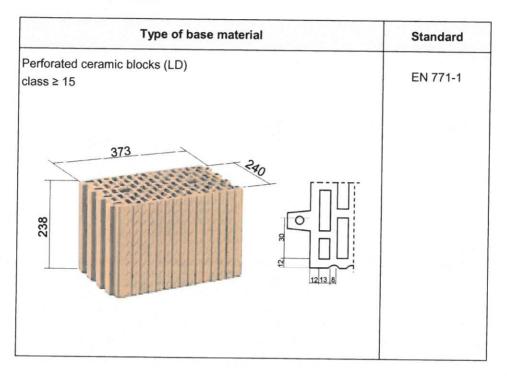





Table B2: Installation parameters of anchor rods with perforated sleeves

Size		M10
Size of rod	d <sub>nom</sub> [mm]	10
Size of sleeve	d <sub>s</sub> x l <sub>s</sub> [mm]	16 x 85
Drill hole diameter	d <sub>o</sub> [mm]	16
Depth of drilled hole to deepest point	h <sub>1</sub> [mm]	90
Effective anchorage depth	h <sub>ef</sub> [mm]	85
Torque moment	T <sub>inst</sub> [Nm]	4

Table B3: Maximum processing times and minimum curing times of MULTIFIX PSF resine mortar

Masonry temperature [°C]	Maximum processing (working) time [Minutes]	Minimum curing (loading) time [Minutes]
-5	50	90
5	18	30
15	8	20
25	3	20
35	2	20

MULTIFIX PSF	Annex B3
Intended use Installation parameters, processing and curing times	of European Technical Assessment ETA-15/0342

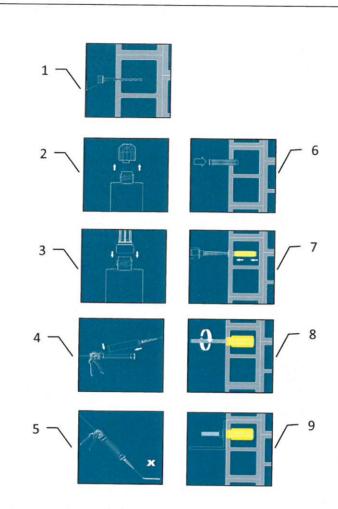

- 1 Drill the hole using a rotary machine to the correct diameter and depth
- 2 Remove the sealing cap
- 3 Screw on the mixing nozzle
- 4 Place the cartridge into the applicator gun
- 5 Dispense the first part (~ 10 cm) to waste until an even color is achieved
- 6 Introduce the sleeve
- 7-Insert the nozzle to the end of the sleeve and inject the resin so long till the sleeve will fill into 100%
- 8 Insert the anchor, slowly with a slight twisting motion into the sleeve
- 9 Remove excess resin and leave the fixing until minimum curing (loading) time has elapsed

# MULTIFIX PSF Annex B4 of European Technical Assessment ETA-15/0342

Table C1: Characteristic tension load and shear load values

Brick parameters:  Density q [kg/m³]  Compressive strength fb [N/mm²]	Sleeve	Anchor size	Effective anchorage depth h <sub>ef</sub> [mm]	Characteristic resistance N <sub>Rk</sub> [kN] <sup>1)</sup>	Characteristic resistance V <sub>Rk</sub> [kN] <sup>2), 3)</sup>
q ≥ 900	16 x 85	M10	85	3,0	1,25
f <sub>b</sub> ≥ 12		III 10	00	3,0	1,25

Partial safety factor  $\Upsilon_{M} = 2,5$ 

 $N_{Rk} = N_{Rk,p} = N_{Rk,b} = N_{R,pb} = N_{Rk,s}$ 

4) In absence of other national regulations

Table C2: Characteristic bending moment

Characteristic bending moment	M <sub>Rk,s</sub> [Nm]	37,38
Partial safety factor	γмѕ	1,25 <sup>1)</sup>

<sup>1)</sup> if no other national regulations exist

Table C3: Displacements under tension and shear load

N [kN]	δ <sub>NO</sub> [mm]	δ <sub>N∞</sub> [mm]	V [kN]	δ <sub>V0</sub> [mm]	$\delta_{V_{\infty}}$ [mm]
1,3	0,09	0,15	2,5	0,8	2,5

### **MULTIFIX PSF** Annex C1 of European **Performances Technical Assessment** Characteristic tension load and shear load values, ETA-15/0342 characteristic bending moment, displacements

<sup>1)</sup> For design according to ETAG 029, Annex C

<sup>2)</sup> For design according to ETAG 029, Annex C  $V_{Rk} = V_{Rk,b} = V_{Rk,c} = V_{Rk,s}$ 

<sup>3)</sup> V<sub>Rk</sub> calculated according to ETAG 029 (Edition April 2013), Annex C, Section C.5.2.2.5


Table C4:  $\beta$ -factor for job site tests according to ETAG 029, Annex B

Temperature	β-factor		
-40°C to 80°C	0,95 x 0,91 = 0,86		

Table C5: Edge distances and spacings

Size d <sub>nom</sub> + Φd x L [mm]	S <sub>cr</sub> [mm]	s <sub>min</sub> [mm]	c <sub>min</sub> [mm]
10 + Φ16 x 85	I <sub>unit, max</sub>	l <sub>unit, max</sub>	≥ 100

 $I_{\text{unit, max}}-$  maximal length of masonry unit

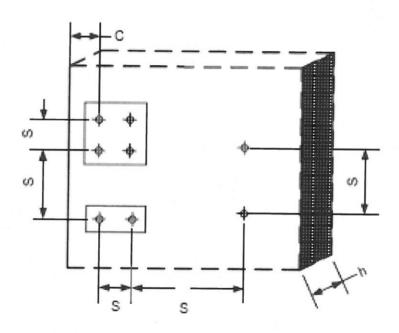

# MULTIFIX PSF Annex C2 of European Technical Assessment ETA-15/0342